

NOTES

GRATE: See details on **SCD CB-1.1.**

If necessary, bicycle safe grates shall be specified in the plans. Bicycle safe grates shall be Neenah No. R-4859-C or East Jordan No. 5110 Type M3 or approved equals.

As of January 1, 2003, the following text shall be cast into the top of the grate:

"DUMP NO WASTE" and "DRAINS TO WATERWAY"

Text shall be printed in bold, capital letters with a minimum height of 1/2". "WATERWAY" may be substituted with "STREAM", "RIVER", "LAKE", etc. Actual placement and logo may vary per manufacturer.

WALLS: Brick or cast-in-place walls shall have a nominal thickness of 8" [200]. Precast walls shall have a minimum thickness of 6" [150] and be reinforced sufficiently to permit shipping and handling without damage. Precast tops shall be 8" [200] thick.

STEPS: Steps shall be provided where the depth exceeds 6' [1.8 m] and shall meet the requirements of **SCD MH-1.1.**

CONCRETE: Cast-in-place concrete is to be Class C. All precast concrete shall meet the requirements of CMS 706.13 and be marked with the catch basin number.

REINFORCEMENT: Reinforcing in the top is to be #4 [#13M] bars spaced at 6" [150] center to center. For Catch Basin No. 2-3 use eight bars and for Catch Basin No. 2-4 use twelve bars.

INLETS OVER 12 FEET [3.5 m] IN DEPTH: Shall be precast or cast-in place concrete; reinforced with #4 [#13M] bars on 12" [300] centers both vertically and horizontally with 2" [50] clearance from inside wall face.

PRECAST BASE: If a precast base is used, it shall be set deep enough so that the top can be placed on the base to provide the grate elevation specified in the plans. Layers of brick shall not be used to adjust the top elevation.

LOCATION AND ELEVATION: When given on the plans, the location and the elevation are at the top center of the grate. When side openings are provided, the elevation shall be at the flow line of the side inlet.


MINIMUM DEPTH: The minimum depth of CB No. 2-3 and CB No. 2-4 shall be the outside diameter (O.D.) of the outlet pipe plus 7" [175].

OPENINGS: Pipe openings shall be the O.D. of the pipe being supplied plus 2" [50] when prefabricated or field cut. The interstitial space shall be filled with grout per CMS 601.


SIDE INLETS: Inlets shall be provided on both sides of the No. 2-3 and 2-4 catch basin in sags and on upstream side only where the ditch has a continuous down grade past the catch basin. Catch basins with side inlets shall not be used within the Clear Zone.

PAYMENT: All materials and labor, including excavation and backfill, shall be paid for under **Item 604 - Catch Basin, No. 2-3 or Item 604 - Catch Basin No. 2-4.**


| CATCH BASIN | OUTLET PIPE SIZE |
|-------------|--------------------------|
| 2-3 | 12" to 33" [300 to 825] |
| 2-4 | 36" to 42" [900 to 1050] |

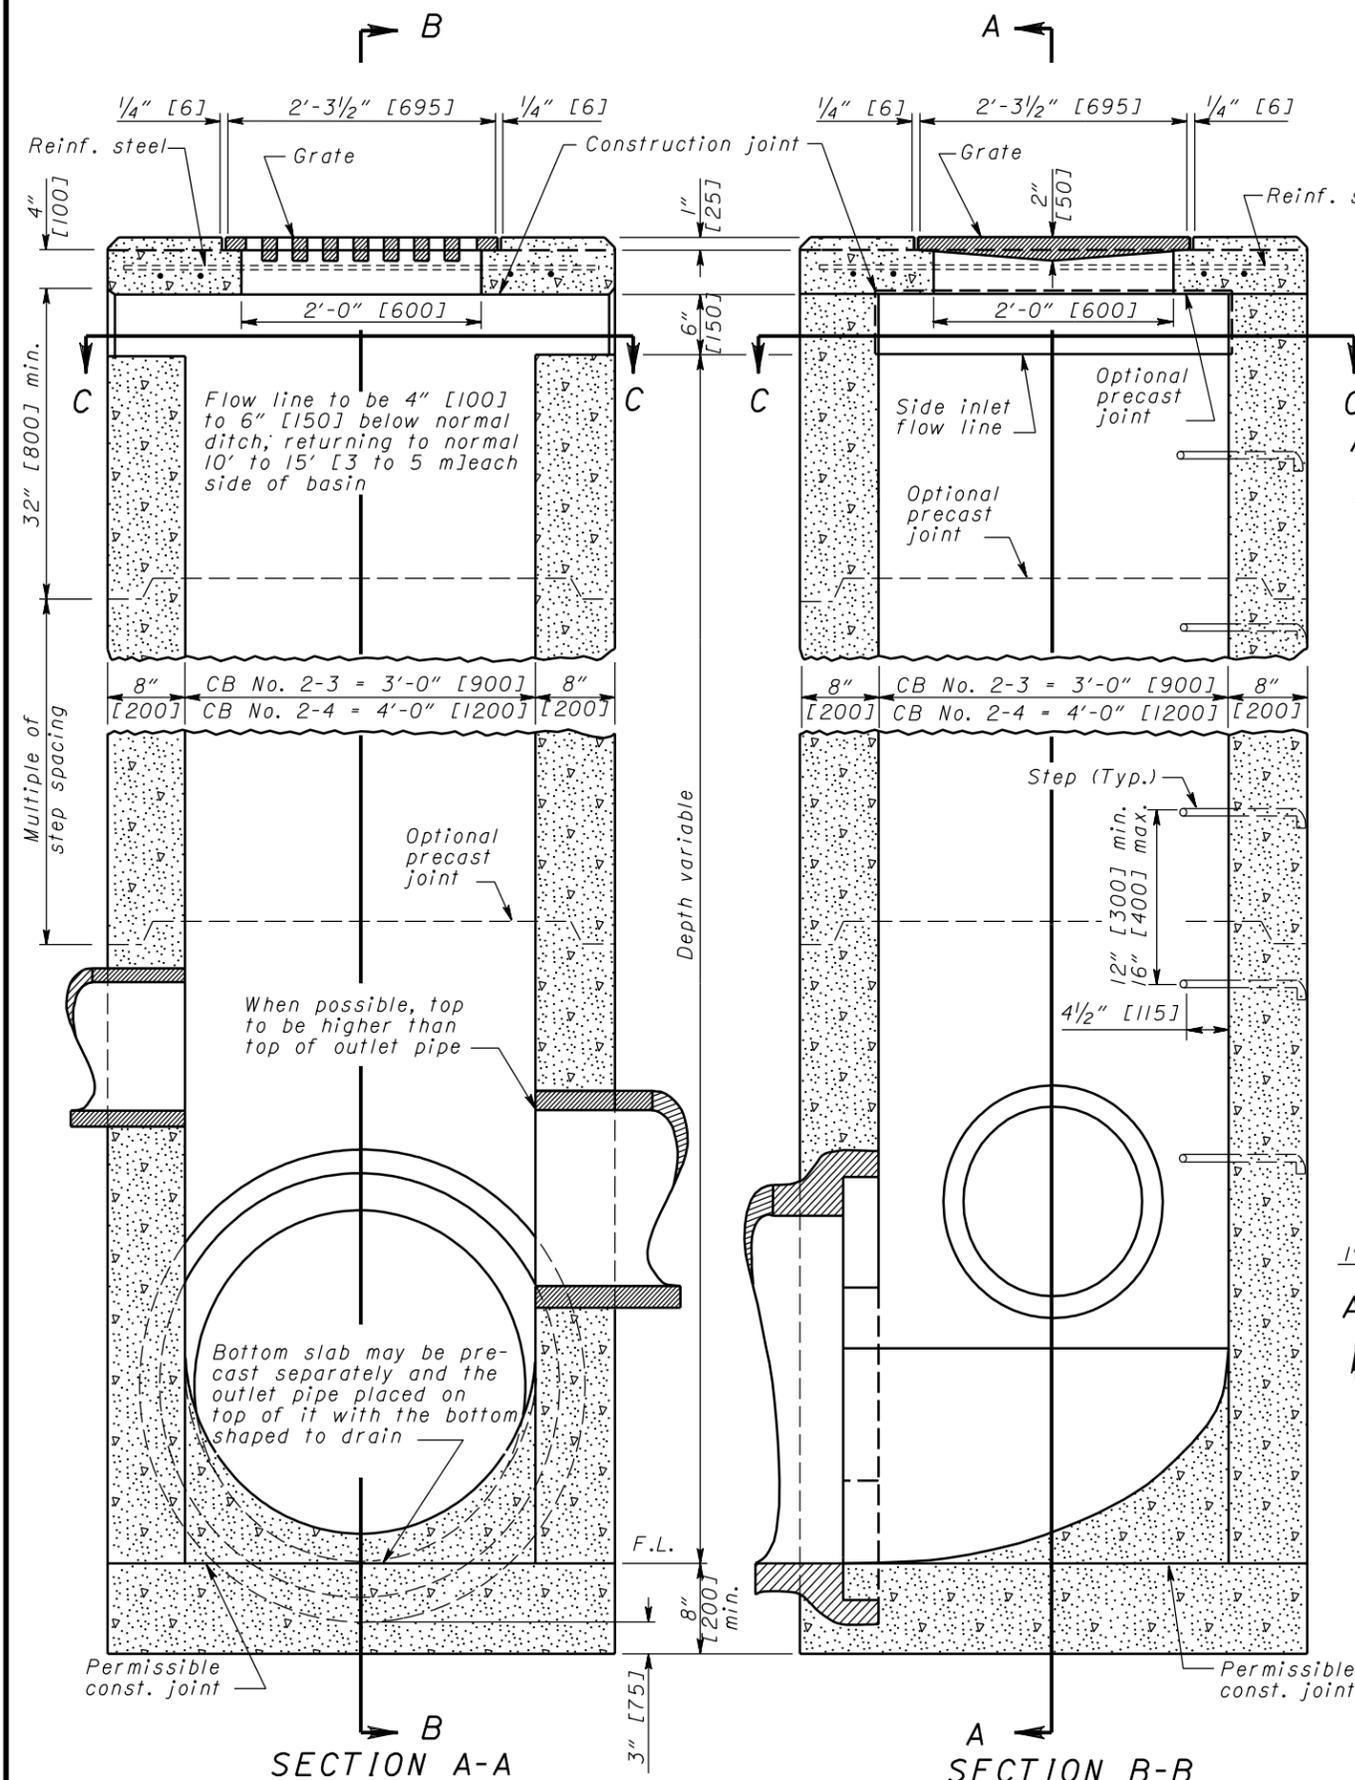

CATCH BASINS No. 2-3 & No. 2-4

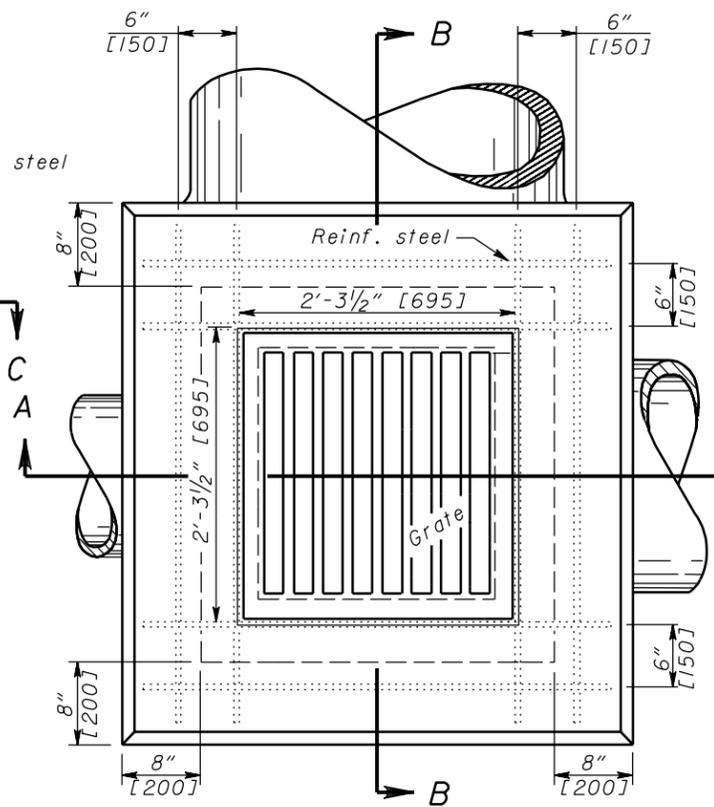

PLAN

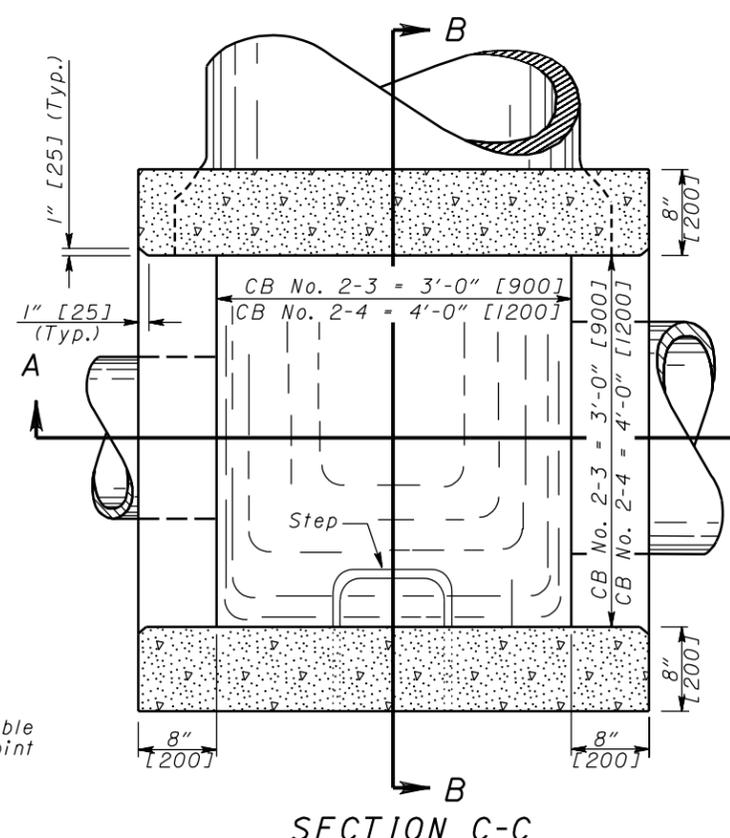

SECTION C-C

OHIO DEPARTMENT OF TRANSPORTATION
ENGINEER OF BRIDGES

DATE
7-20-01
7-19-02

HYDRAULIC ENGINEER
D. Gruver

All metric dimensions (in brackets []) are in millimeters unless otherwise noted.

OFFICE OF STRUCTURAL ENGINEERING

STANDARD HYDRAULIC CONSTRUCTION DRAWING
CATCH BASINS No's 2-3 & 2-4

NUMBER
CB-1.2

1/1